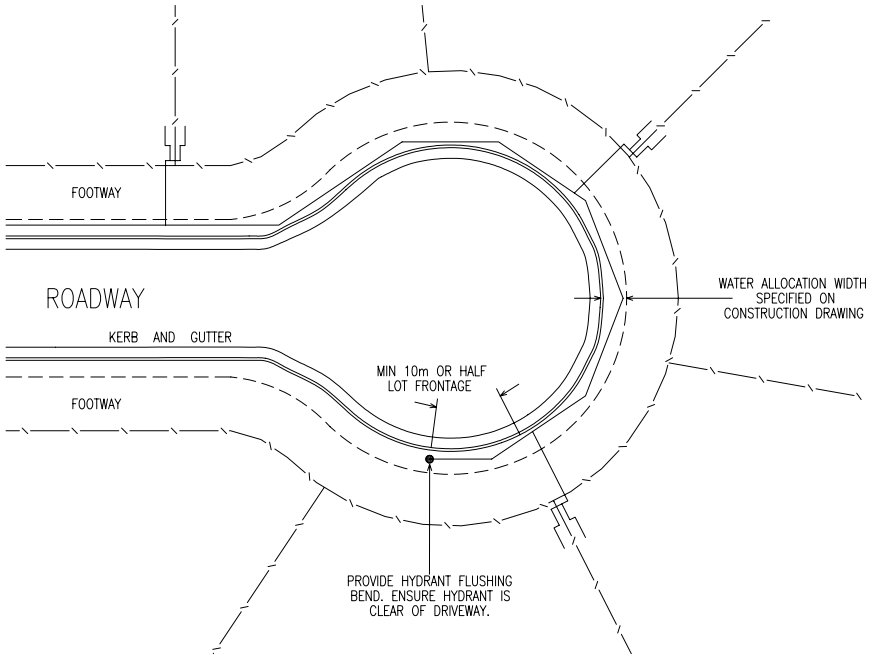

PLAN

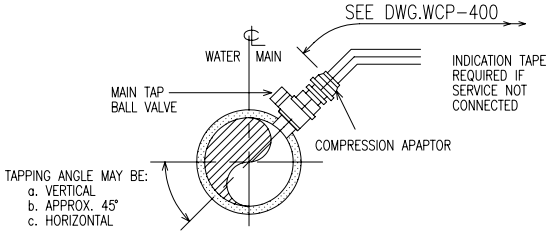

FOR TAPPING DETAILS
SEE DRAWING WCP-200
(POLYETHYLENE SLEEVING NOT SHOWN)

ENLARGED SECTION A

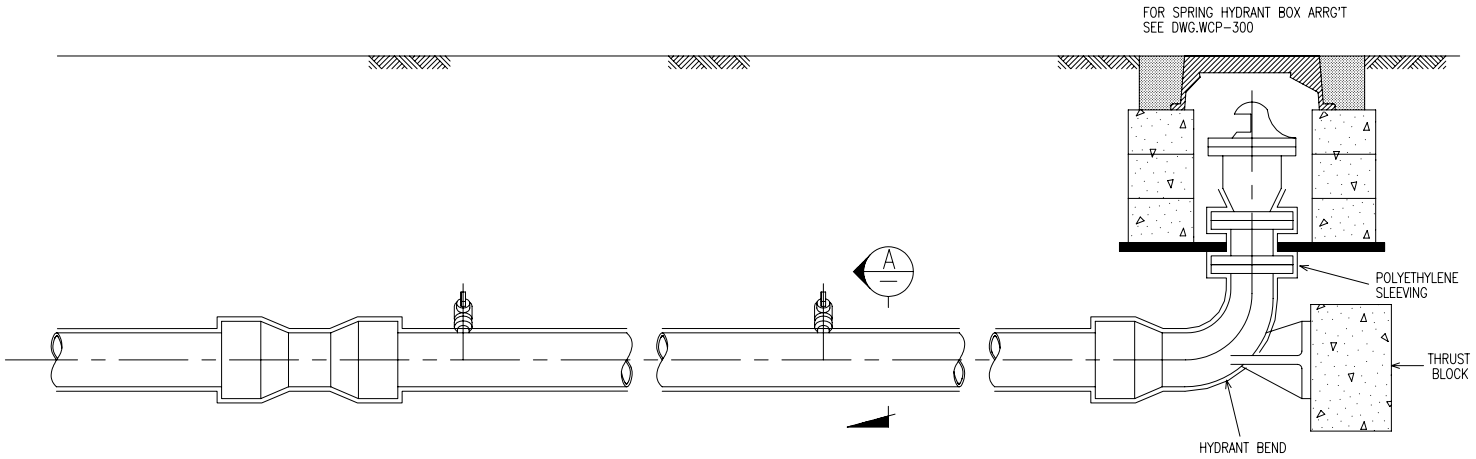

LONGITUDINAL SECTION

NOTES:

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH SPECIFICATION STS-401
2. LAY WATERMAIN WITHIN WATER ALLOCATION, AS SPECIFIED ON CONSTRUCTION DRAWING. DO NOT LAY WATERMAIN UNDER CONCRETE KERB.
3. USE BENDS, AS REQUIRED, TO SUIT. ENSURE ALL BENDS ARE PROPERLY SUPPORTED AND THRUST BLOCKS ARE WITHIN WATER ALLOCATION.
4. MINIMUM LENGTH OF SHORT PIPE BETWEEN JOINTS TO BE 2.7m, IE. HALF FULL PIPE LENGTH.
5. PROVIDE END LOT WITH MINIMUM 10m OR HALF LOT FRONTAGE. ENSURE HYDRANT IS CLEAR OF DRIVEWAY.

REV. N°	REVISION	APPROVED	DATE

© COPYRIGHT HUNTER WATER CORPORATION LIMITED.

APPROVED
MANAGER
CEC CONSULTING ENGINEERS

APPROVED
MANAGER
PLANNING AND DEVELOPMENT

HUNTER WATER CORPORATION
A.C.N. 053 102 837

STANDARD CONSTRUCTION PRACTICE
WATER STANDARD

MAINLAYING
DN 100 DICL WATERMAIN IN CUL-DE-SAC

CAD FILE NAME: WCP-208

HWCS

WCP-208

ISSUED: 1997 | A3