



SECTIONAL ELEVATION A-A

CONCRETE PIPE MANUFACTURER	VALVE PIT DN	ACTUAL OUTSIDE DIAMETER	MINIMUM WALL THICKNESS	MAX. INSIDE DIAMETER	MARK	
					BEAM	COVER
HUMES	1800	2005	115	1775	A-602	A-601
	2100	2388	125	2138	C-602	C-601
ROCLA	1800	2019	114	1791	B-602	B-601
	2100	2336	135	2066	D-602	D-601

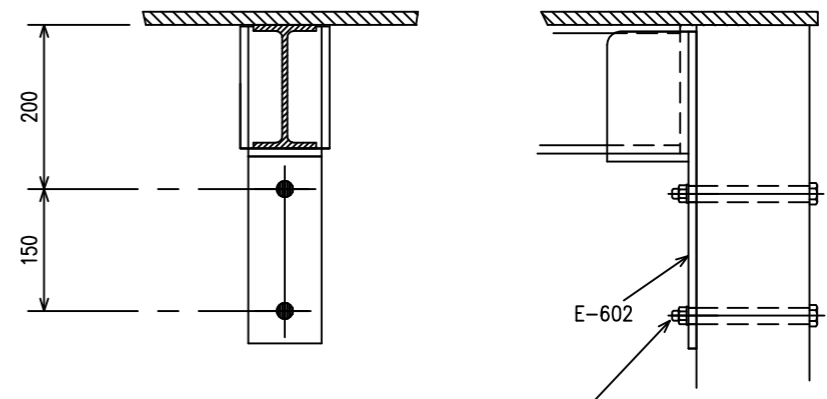

M16 x 170 LG. HEX. HEAD BOLT
C/W NUT AND FLAT WASHER (ALL H.D. GALVANISED)

DETAIL 1

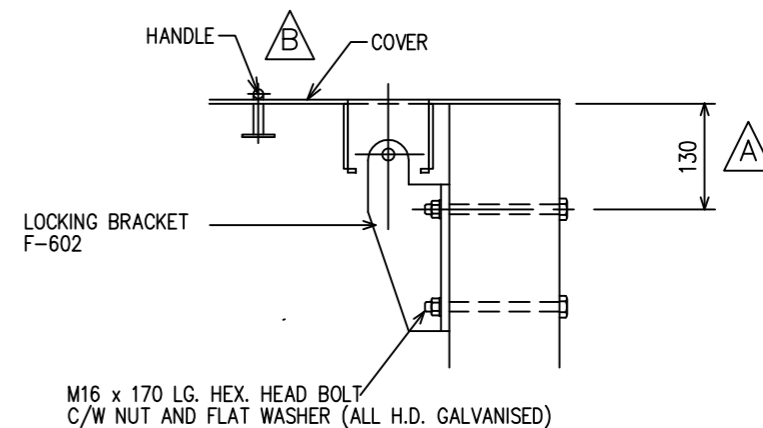

M16 x 170 LG. HEX. HEAD BOLT
C/W NUT AND FLAT WASHER (ALL H.D. GALVANISED)

TYPICAL SECTION B

NOTES:

- ITEMS DETAILED ON DRG -601 & -602 ARE BASED ON PIPE SIZES AS SHOWN ON THIS DRAWING. THESE PIPE SIZES SHALL BE CHECKED PRIOR TO FABRICATION OF THOSE ITEMS AND ALLOWANCES MADE ACCORDINGLY.
- ALL COVER PLATES TO BE PERMANENTLY MARKED WITH THE LETTERS "HWC". LETTERS TO BE ROUTED AT TYPICAL 2mm DEPTH.

3	NOTE 2 AMENDED AND TITLE BLOCK UPDATED. VALVE PIT BEAM, PIT COVERS AND LOCKING BOX UPDATED TO SUIT LADDER POSITION	S.H.	01-06-16
2	LOCK BOX ALTERED SECTION A & PLAN VIEW	J.R.G.	10-12-02
1	DIMENSIONS ALTERED SECTION A. LETTER MARKING ADDED	J.R.G.	01-07-02
REV. N°	REVISION	APPROVED	DATE

© COPYRIGHT HUNTER WATER CORPORATION

APPROVED

MANAGER
ASSET MANAGEMENT



STANDARD CONSTRUCTION PRACTICE
SEWERAGE STANDARD

SEWAGE PUMPING STATIONS
CIRCULAR VALVE PIT COVER
MARKING PLAN

CAD FILE NAME: SCP-600

SCP-600

ISSUED: 2016

A3