


NOTES:

1. ALL SANITARY DRAINAGE SHALL BE INSTALLED TO THE REQUIREMENTS OF AS/NZS 3500.2.
2. VENTS AND OVERFLOW RELIEF GULLIES SHALL TERMINATE ABOVE KNOWN FLOOD LEVELS.
3. PUMPS SHALL DELIVER NO MORE THAN 0.41L/SEC AT 20METRES HEAD AT THE CONNECTION TO HUNTER WATER SEWER MAIN.

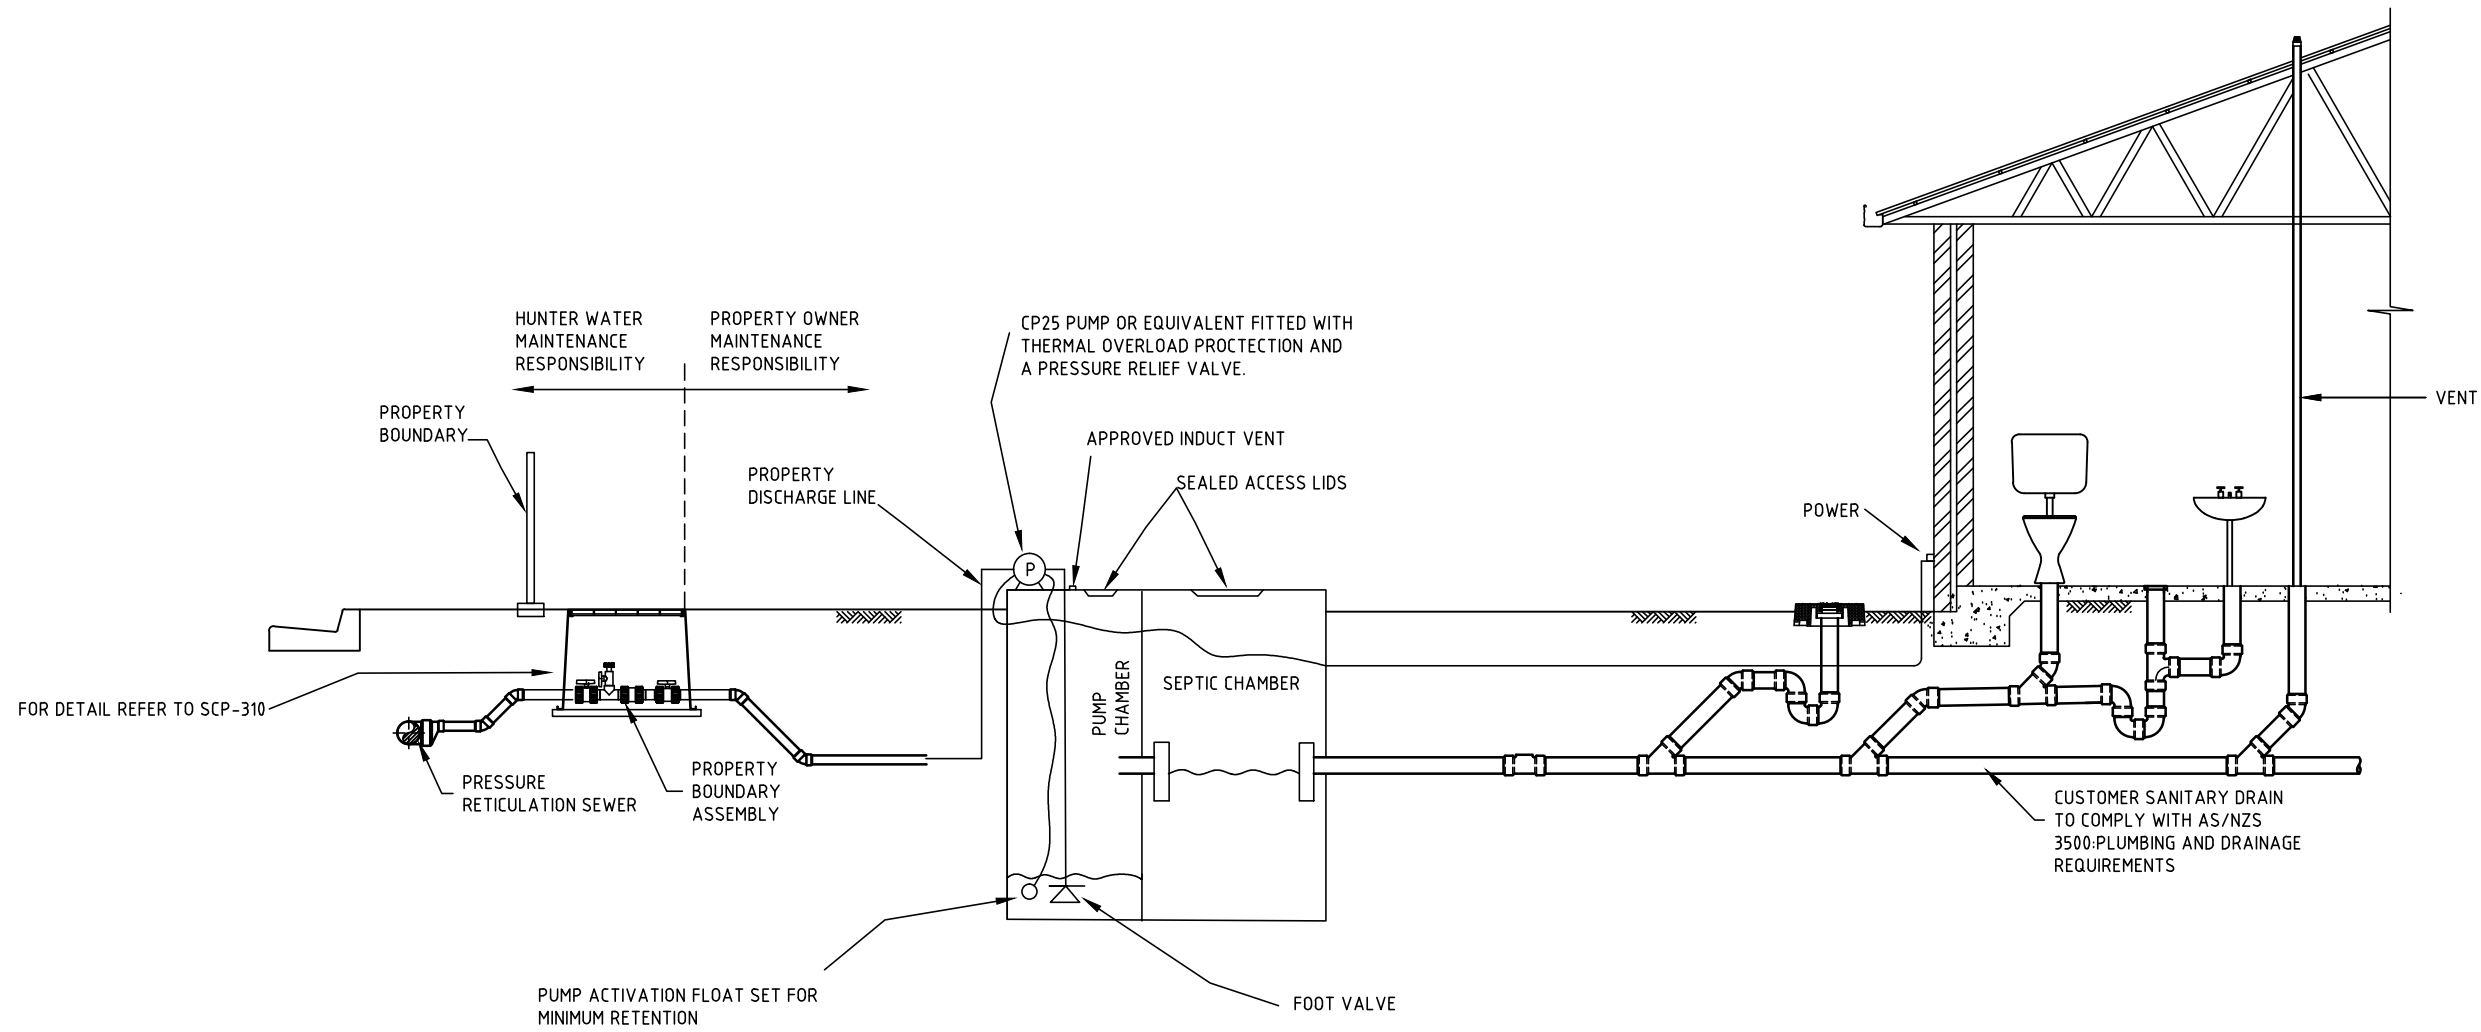

TYPICAL COMMON EFFLUENT PUMP SYSTEM (CEP)

2	REVISION	G.H.	01.09.2015
1	REVISION by GREG HEANEY	G.H.	12.12.2013
0	CONSTRUCTION ISSUE	G.H.	04.07.2012
REV No.	REVISION	APPROVED	DATE

APPROVED  
MANAGER ASSET MANAGEMENT  
HUNTER WATER CORPORATION (H.W.C.)



© COPYRIGHT HUNTER WATER CORPORATION LIMITED.

STANDARD CONSTRUCTION PRACTICE  
**SEWERAGE STANDARD**

SERVICE CONNECTION STANDARD  
TYPICAL (CEP) DETAIL

CAD FILE NAME: TSS-001 TYPICAL CEP DETAIL

HWCS

**TSS-001**

ISSUED: OCTOBER 2015

A3