


NOTES

1. ALL SANITARY DRAINAGE SHALL BE INSTALLED TO THE REQUIREMENTS OF AS/NZS 3500.2.
2. HUNTER WATER RECOMMEND ON ALL DEVELOPMENTS FOR THE DOWNSTREAM INSPECTION OPENING TO BE EXTENDED TO FINISHED GROUND LEVEL AND TERMINATE WITH AN AIR TIGHT REMOVABLE LID TO PREVENT THE NEED OF EXCAVATION DURING MAINTENANCE.
3. ALL VENTS AND OVERFLOW RELIEF GULLIES SHALL TERMINATE ABOVE KNOWN FLOOD LEVELS.

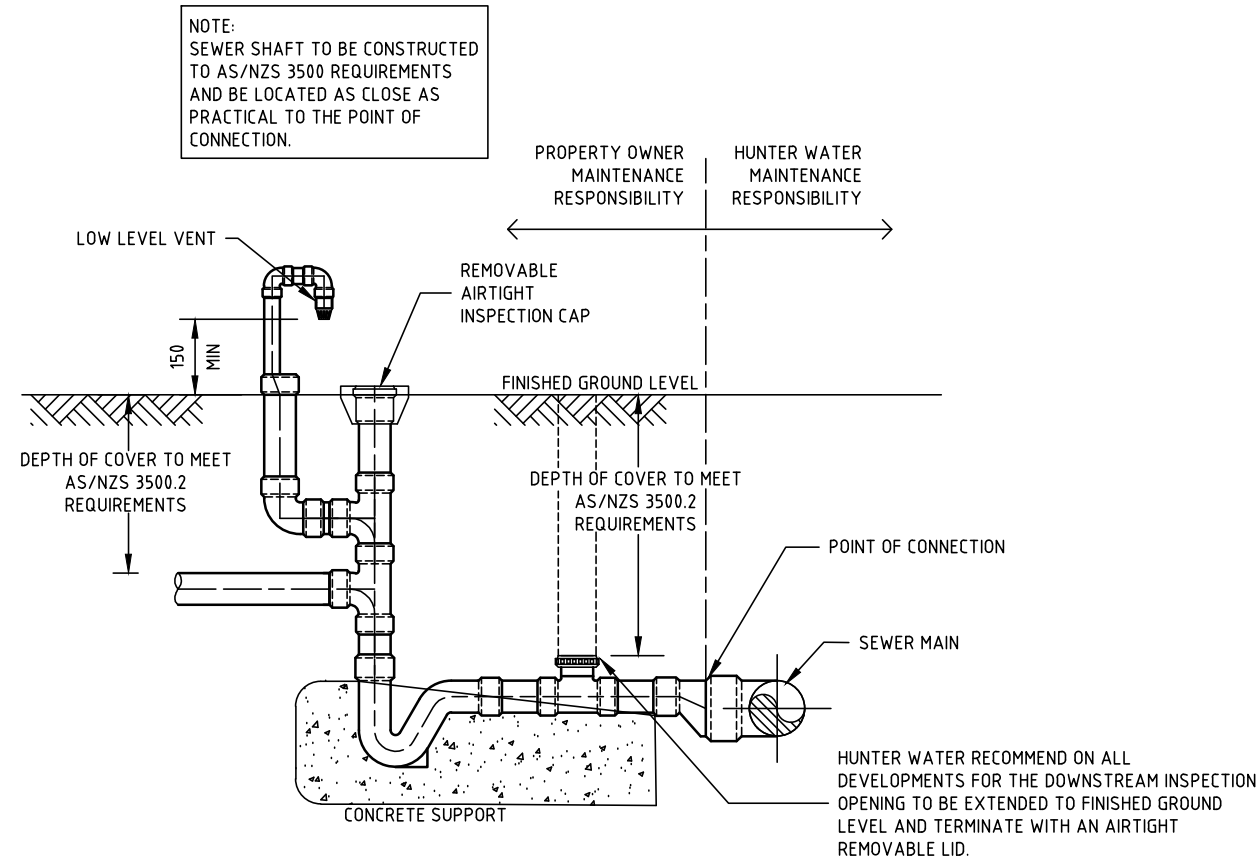

TYPICAL BOUNDARY TRAP SEWER SHAFT - RESIDENTIAL

2	REVISION	G.H.	01.09.2015
1	REVISION by GREG HEANEY	G.H.	12.12.2013
0	CONSTRUCTION ISSUE	G.H.	04.07.2012
REV No.	REVISION	APPROVED	DATE
		APPROVED MANAGER ASSET MANAGEMENT HUNTER WATER CORPORATION (H.W.C.)	



STANDARD CONSTRUCTION PRACTICE
SEWERAGE STANDARD

SERVICE CONNECTION STANDARD
BOUNDARY TRAP SEWER SHAFT-RESIDENTIAL
(GUIDE ONLY)

CAD FILE NAME: TSS-006 BDY TRAP SEWER SHAFT

HWCS

TSS-006

ISSUED: OCTOBER 2015 | A3