


TO BE INSTALLED ON:

- CEP
- PPSS
- HWPSS

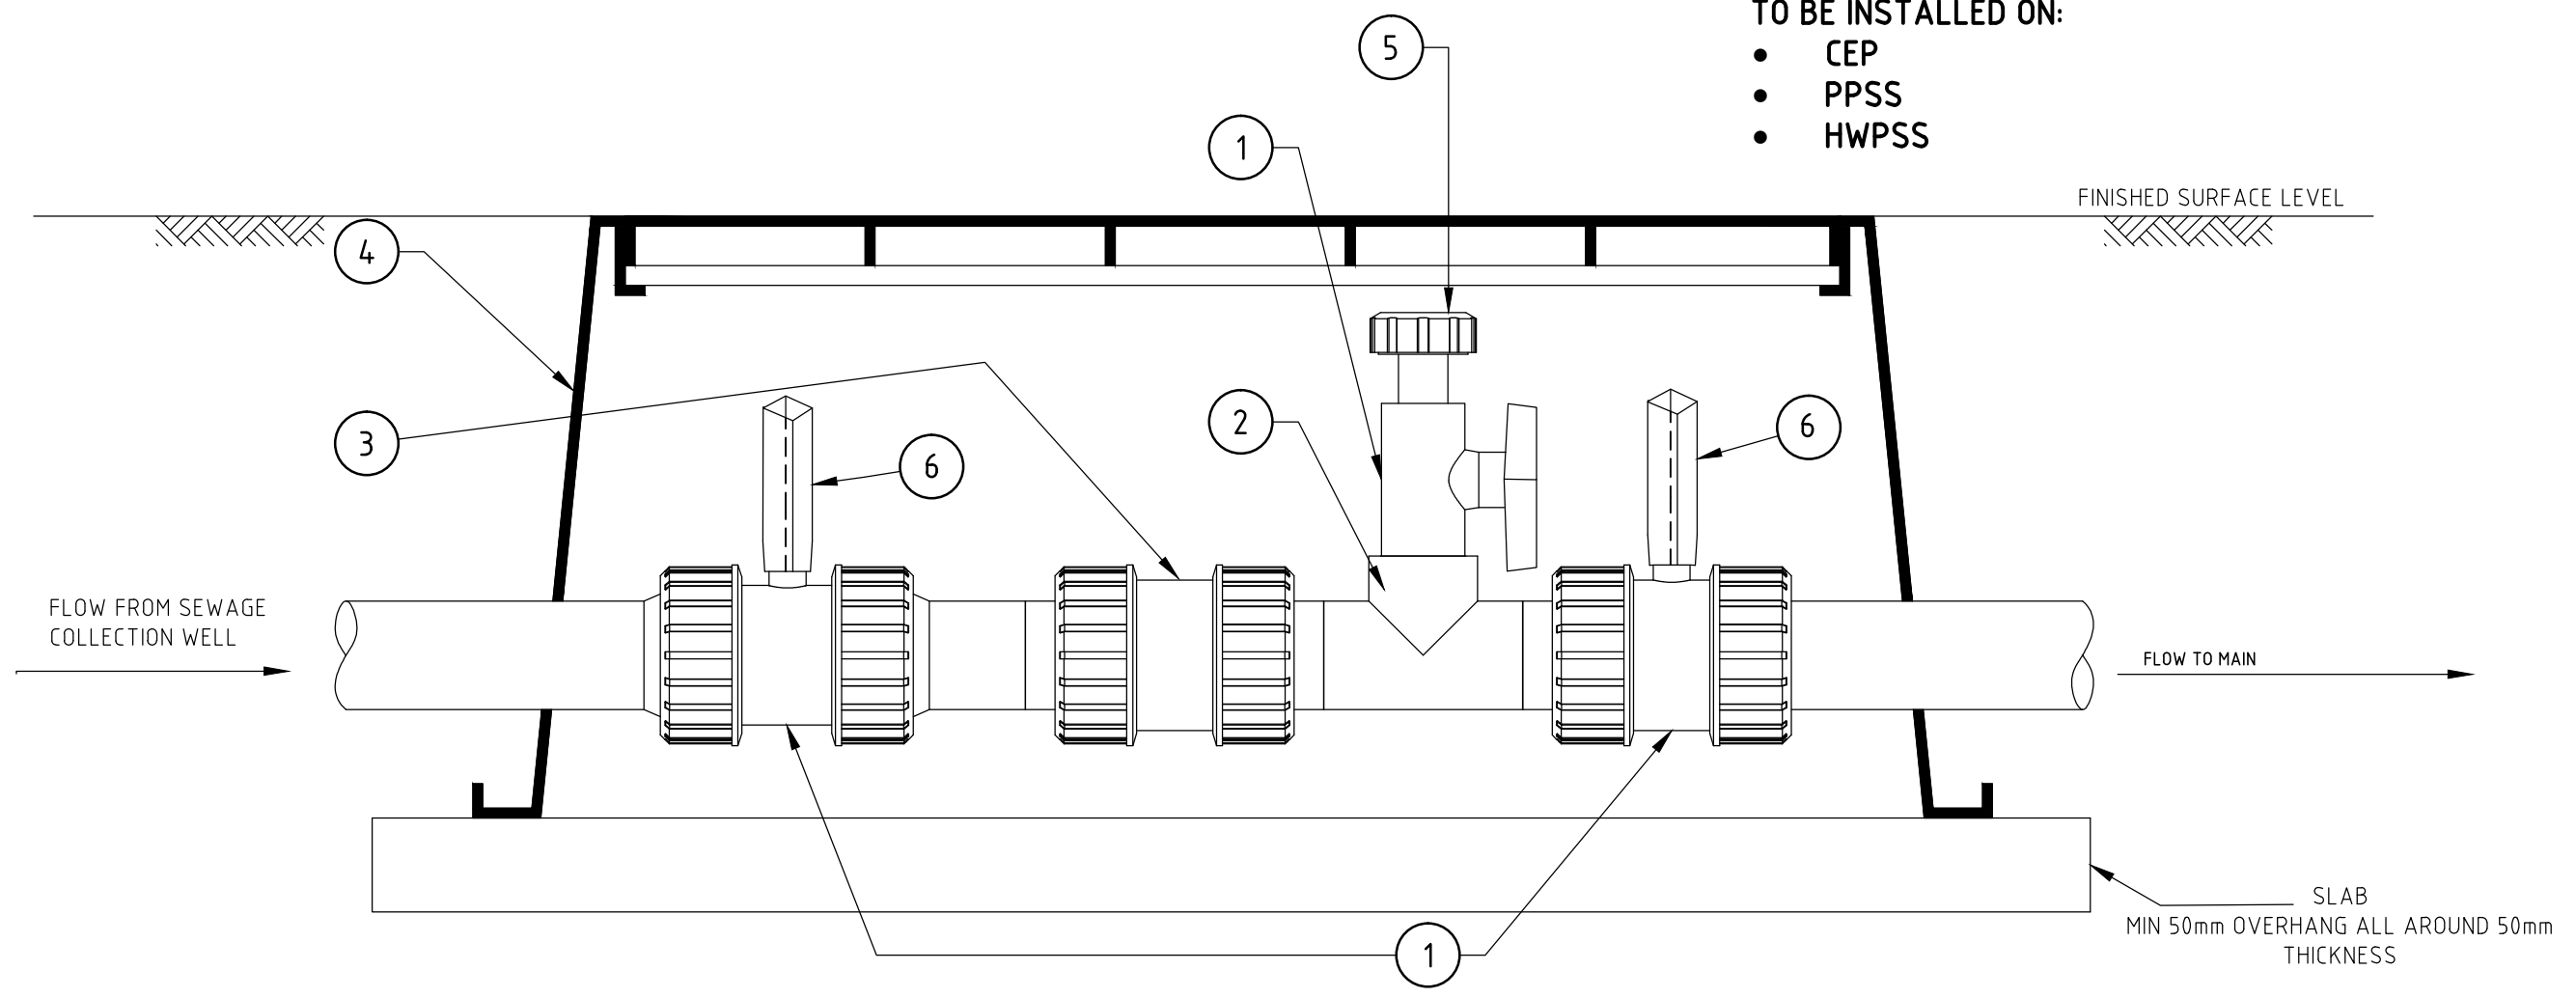

TYPICAL BOUNDARY KIT

NOTE:
ALL PIPEWORK AND FITTINGS TO COMPLY WITH AS/NZS 5200 AND AS/NZS 3500 REQUIREMENTS

- NOTES:**
1. INSTALLATION OF UNIONS REQUIRED TO ALLOW ASSEMBLY AND DISASSEMBLY OF BOUNDARY KIT COMPONENTS.
 2. VALVES AND PIPE FITTINGS TO BE CONSTRUCTED OF STAINLESS STEEL.

- 1 BALL VALVE WITH STANDARD HANDLE
- 2 TEE
- 3 NON RETURN VALVE
- 4 HOUSING BOX
- 5 CAP/PLUG (SCREWED)
- 6 BALL VALVE WITH SQUARE HEAD HANDLE

2	REVISION	G.H.	01.09.2015
1	REVISED by GREG HEANEY	G.H.	12.12.2013
0	CONSTRUCTION ISSUE	G.H.	04.07.2012
REV No.	REVISION	APPROVED	DATE
		APPROVED MANAGER ASSET MANAGEMENT HUNTER WATER CORPORATION (H.W.C.)	



STANDARD CONSTRUCTION PRACTICE
SEWERAGE STANDARD

SERVICE CONNECTION STANDARD
BOUNDARY KIT DETAIL

CAD FILE NAME: SCP-310 (TYPICAL BOUNDARY KIT)

HWCS

SCP-310

ISSUED: OCTOBER 2015