


NOTES

1. ALL SANITARY DRAINAGE SHALL BE INSTALLED TO THE REQUIREMENTS OF AS/NZS 3500.2.
2. VENTS AND OVERFLOW RELIEF GULLIES SHALL TERMINATE ABOVE KNOWN FLOOD LEVELS.
3. HUNTER WATER REQUIRES THE PUMP FLOAT LEVELS BE SET FOR MINIMUM RETENTION WITH NO CONTENTS TO BE STORED FOR MORE THAN A 4 HOUR PERIOD.
4. PUMPS SHALL DELIVER NO MORE THAN 0.8L/SEC AND A MAXIMUM OF 60 METRES HEAD AT THE CONNECTION TO HUNTER WATER SEWER MAIN.

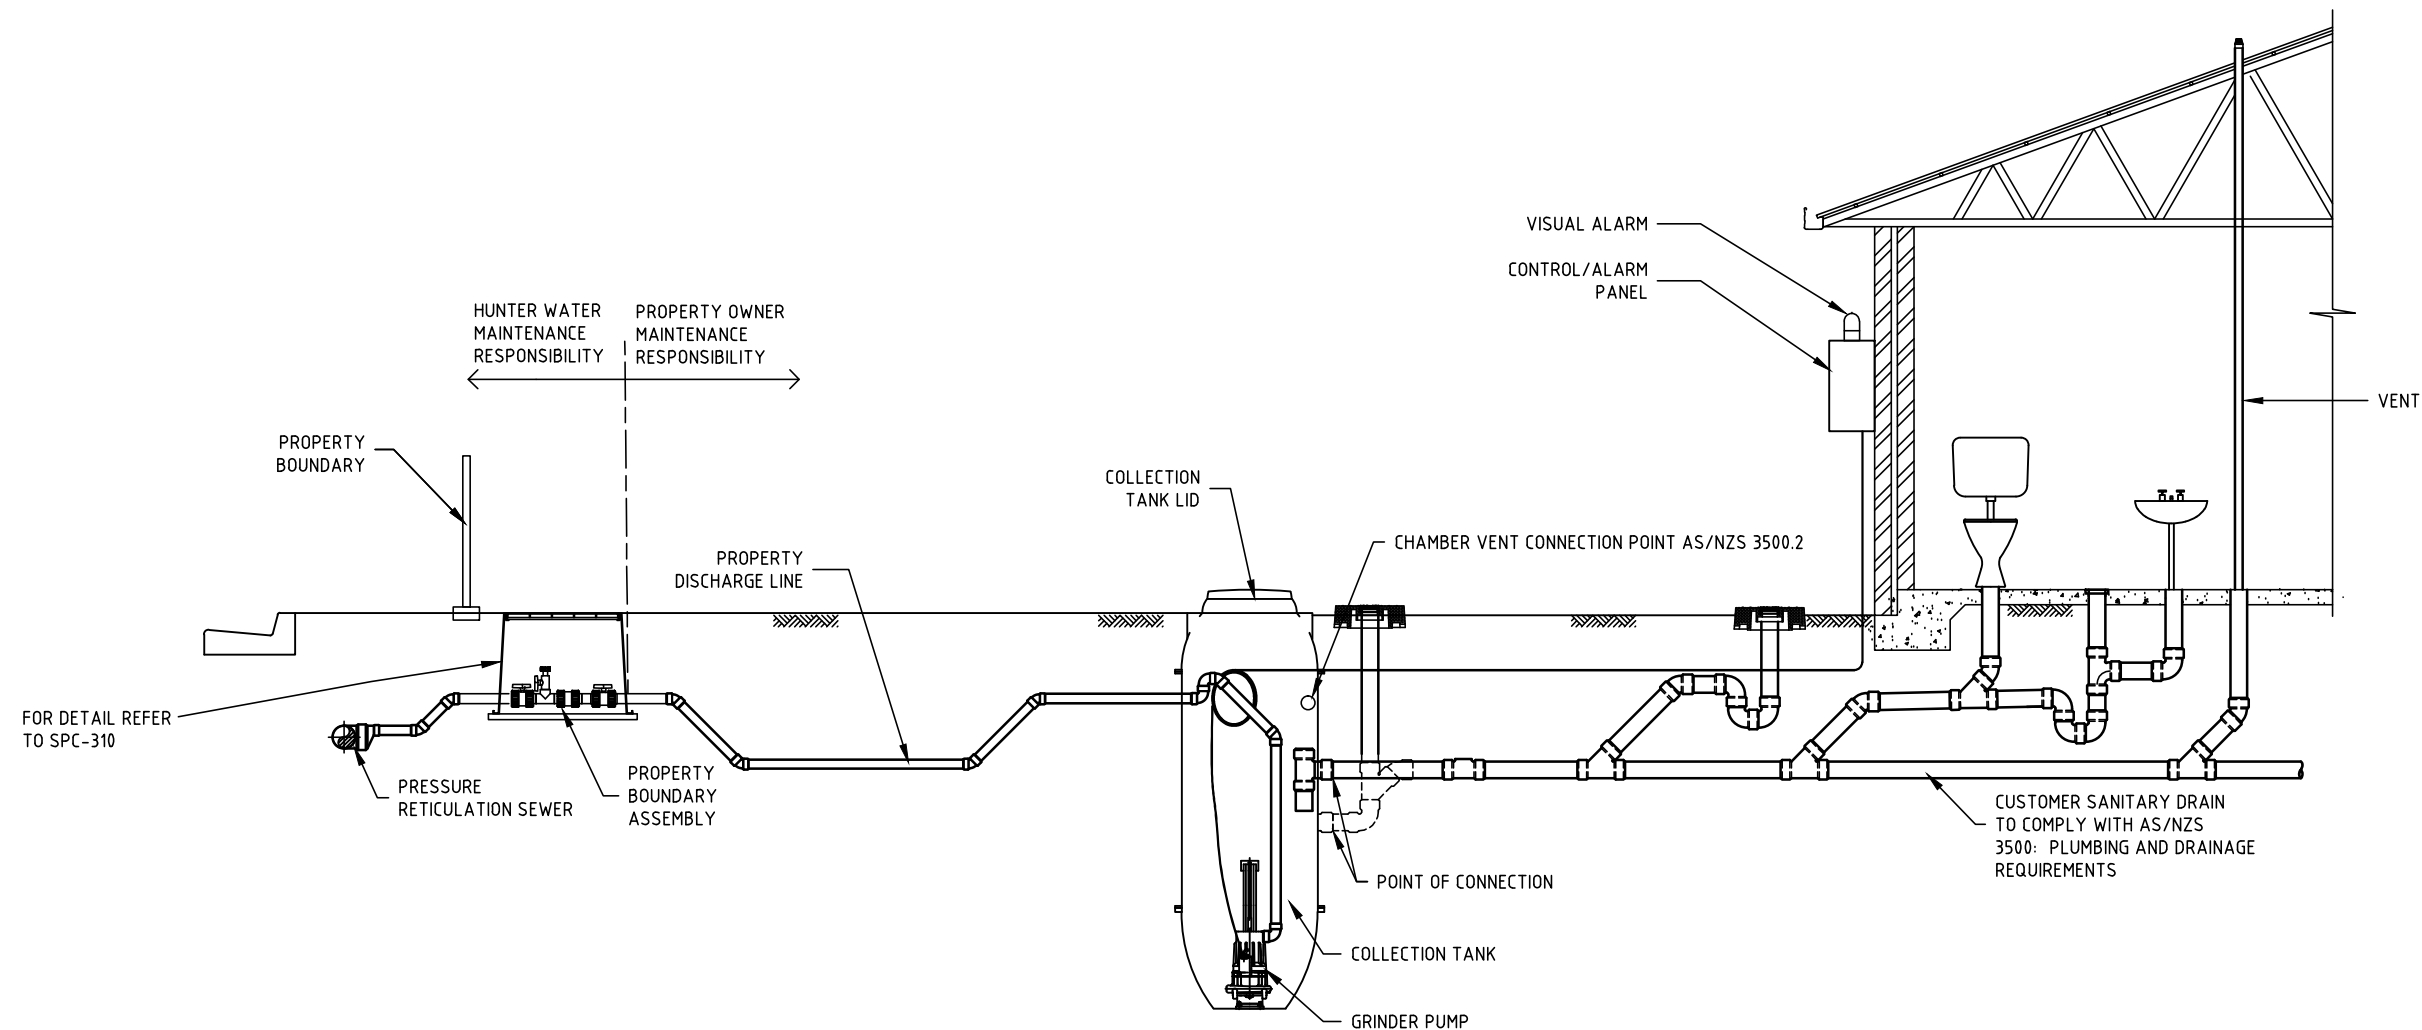

TYPICAL PRIVATE PRESSURE SEWERAGE SYSTEM (PPSS)

2	REVISION	G.H.	01.09.2015
1	REVISION by GREG HEANEY	G.H.	12.12.2013
0	CONSTRUCTION ISSUE	G.H.	04.07.2012
REV No.	REVISION	APPROVED	DATE

APPROVED
MANAGER ASSET MANAGEMENT
HUNTER WATER CORPORATION (H.W.C.)



© COPYRIGHT HUNTER WATER CORPORATION LIMITED.

STANDARD CONSTRUCTION PRACTICE
SEWERAGE STANDARD

SERVICE CONNECTION STANDARD
TYPICAL (PPSS) DETAIL

CAD FILE NAME: TSS-002 TYPICAL (PPSS) DETAIL

HWCS
TSS-002

ISSUED: OCTOBER 2015

A3