
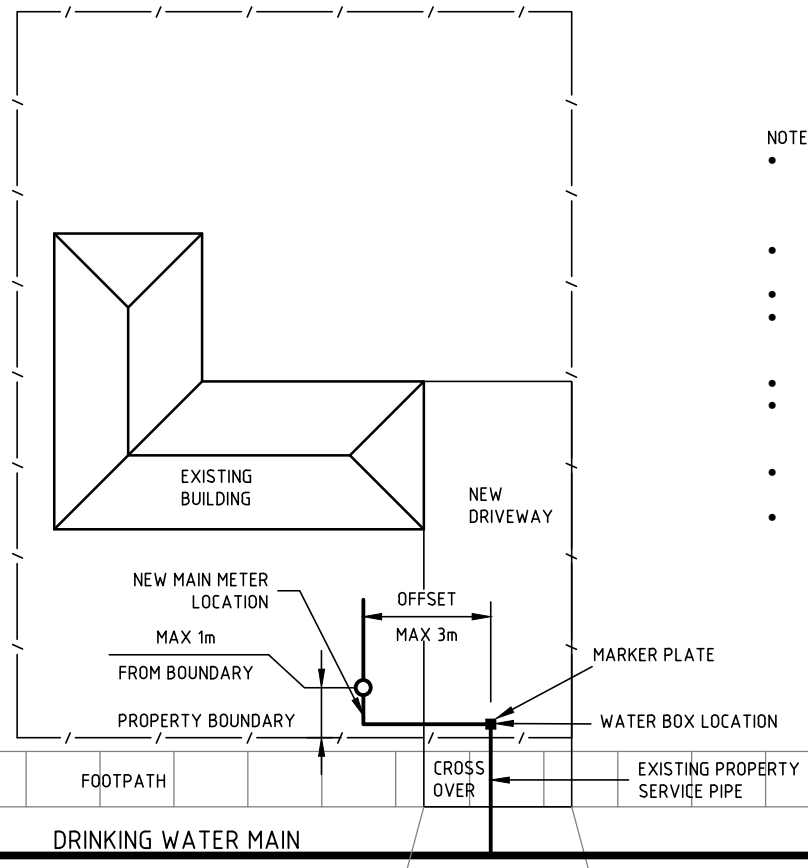


WATER BOX DETAIL



NOTE:

- IF OFFSET TO BE GREATER THAN 3m THE EXISTING SERVICE SHALL BE DISCONNECTED AT THE WATERMAIN. A NEW SERVICE SHALL BE INSTALLED IN ACCORDANCE WITH THE SERVICES CONNECTION GUIDELINE REQUIREMENTS.
- METER ASSEMBLY MUST BE LOCATED WITHIN 1m OF PROPERTY BOUNDARY
- WATER METERS ARE NOT PERMITTED IN PITS
- APPLIES TO BOTH SHORT AND LONG SIDE SERVICE ONLY APPLICABLE FOR EXISTING DEVELOPMENTS AFTER HUNTER WATER APPROVAL.
- NOT ALLOWED FOR NEW DEVELOPMENTS
- A PERMANENT BRASS OR CAST IRON WATER BOX TO BE INSTALLED IN CONCRETE AT THE CHANGE OF DIRECTION OF THE PIPE
- THE OFFSET SHALL BE LOCATED INTERNAL TO THE PROPERTY BOUNDARY
- THE PROPERTY OWNER SHALL BE ADVISED THAT FUTURE MAINTENANCE OF THE SERVICE MAY REQUIRE THE CONCRETE DRIVEWAY TO BE CUT TO ACCESS THE PIPE

EXISTING OFFSET WATER SERVICE

1	REVISION	G.H.	01.09.2015
0	CONSTRUCTION ISSUE	G.H.	04.07.2012
REV No.	REVISION	APPROVED	DATE
© COPYRIGHT HUNTER WATER CORPORATION LIMITED.		APPROVED MANAGER ASSET MANAGEMENT HUNTER WATER CORPORATION (H.W.C.)	



STANDARD CONSTRUCTION PRACTICE WATER SUPPLY STANDARD
SERVICE CONNECTION STANDARD EXISTING OFFSET WATER SERVICE

CAD FILE NAME: TSW-009 EXIST OFFSET WS
HWCS
TSW-009
ISSUED: OCTOBER 2015
A3